

Single-phase interference suppression filters - series B: for currents 1-16 A

Description :

It is a simple LC circuit consisting of chokes and condensers. In single-phase filters of series SKY1FLxB is a composed choke formed by 2 windings. The used safety condensers of type X are being wired among phases for filtration of symmetrical component. The condensers of type Y are being wired towards the ground for filtration of asymmetric component. They are delivered with terminals in a plastic case.

Functions of the interference suppression filters:

The LC filter is formed by low-pass filter 0 – 9kHz. It reduces a level of radio frequency interference in conductors from the side of appliance and also increases its resistance to interference from the surroundings. The filters function either way. The most effective they are from 150kHz to 30MHz.



TECHNICAL PARAMETERS :

Nominal operating voltage
 Extent of operating frequencies f_n (for I_n)
 Extent of operating currents
 Short-term overcurrent capacity : 50% I_n
 Thermal class : B
 Protection class : IP00
 Extent of operating temperature : -10°C + 40°C


Un : 230 Vac
 Fn : 50-60 Hz
 In : 1-16A

Type	Nominal current [A]	Leakage current 1*) [mA]	Weight [kg]	Conductor cross section [mm ²]	basic dimensions [mm]				
					A	B	C	D	E
					length	height	width	pitch	pitch
SKY1FL1B	1	< 14	0,12	2,5	68,8	34,6	65	60	-
SKY1FL3B	3	< 14	0,18	2,5	68,8	34,6	65	60	-
SKY1FL6B	6	< 14	0,18	2,5	79	43,2	47,3	65	37,5
SKY1FL10B	10	< 14	0,18	2,5	79	43,2	47,3	65	37,5
SKY1FL16B	16	< 14	0,3	2,5	92	48,5	58,6	77,5	47,5
SKY1FL16BN	16	< 14	0,3	2,5	92	48,5	58,6	77,5	47,5


* After a deal there is a possibility of modification of the filter construction according to the customer's request.

1*) Leakage current measurement was performed according to the standard ČSN EN 60950.

Dimensional drawing for: SKY1FL1B - SKY1FL3B

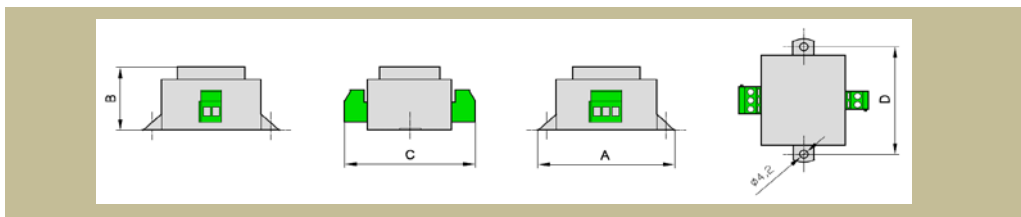

Dimensional drawing for: SKY1FL6B - SKY1FL16BN

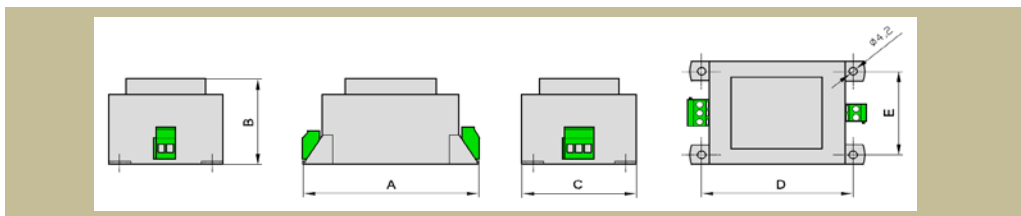

Attenuation characteristic:


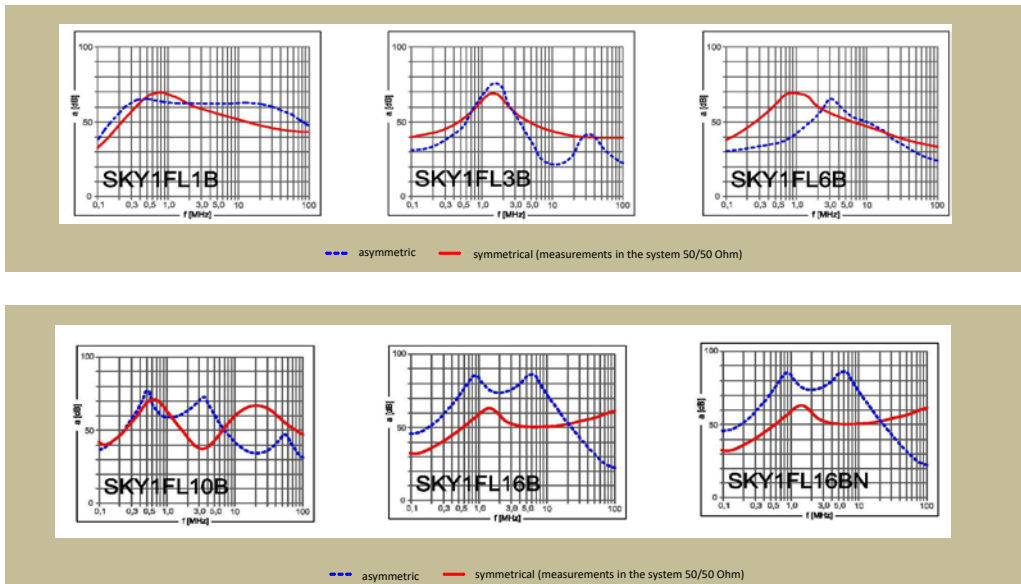


Diagram:

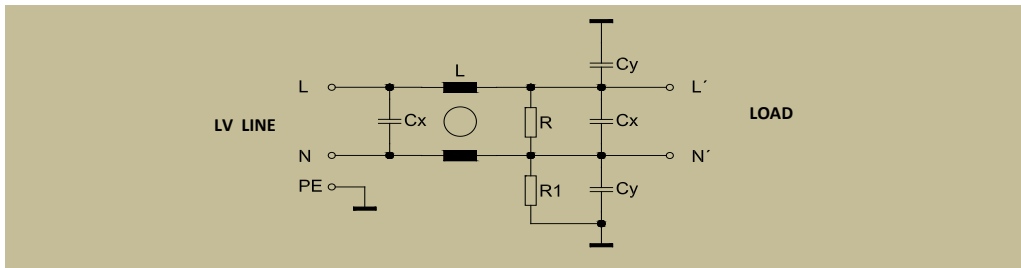

Use:

It is used for frequency converters and appliances which need supplemental interference suppression. For example: soft starters, pulse resources, thyristor controls and electronic units.

Dimensioning, wiring:

They are dimensioned according to indicated label nominal voltage and current values. Short-circuit protection must not exceed nominal current value. When installing into switchboards it is necessary to count with power loss of the filters although it is not as large as the power loss in chokes or in sinusoidal filters. But also it is necessary to provide for sufficient heat removal. When connecting it is necessary to meet the EMC requirements. There must not be any paralleling of interference-suppressed and non-interference-suppressed circuits. The grounding connections must be as short as possible and it is necessary to avoid any ground loops.